



Glass Balustrade Rail Testing
Interior FBC (HVHZ)

Interior and Exterior FBC (Small Missile & above 60 ft. Elevation)
Interior and Exterior International Building Code 2012
Interior and Exterior National Building Code of Canada 2015

August 12, 2016

REPORT NUMBER: **HETI-16-5073**

MANUFACTURER: Arteferro Miami LLC
2955 NW 75th Street, Miami, FL 33147-5943

TEST LOCATION: Hurricane Engineering & Testing Inc.
6120 NW 97th Avenue, Doral, Florida, 33178

NOTIFICATION NUMBER: HETI16013 (MIAMI-DADE COUNTY, FLORIDA)
LAB. CERTIFICATION No.: 15-1216.04 (MIAMI-DADE COUNTY, FLORIDA)
IAS. CERTIFICATION No.: TL-296 (ISO 17025-05)
FBC ORGANIZATION No: TST1691
FBPE Certificate of Authorization Number: 6905

PRODUCT: Max Top Mount
PRODUCT SIZE: 143 7/8" wide x 43 1/2" high (non-fixed end)
144 1/8" wide x 44 3/8" high (fixed end)

TEST SUBSTRATUM: Concrete Compressive strength 4030 PSI, HETI-16-C100
DRAWING NO.: **TP16-05 by MCY Engineering, consisting of ??? page dated 08-10-2016.**

DESIGN LOADS (psf): **+ 65, - 65**

TEST WITNESSED BY: Syed Waqar Ali, Ph. D. (HETI)
Dr. Nasreen K Ali, E. I. (HETI)
Mr. Eugenio Rivera (HETI)
Mr. Joe Martinez (Manufacturer)
Mr. Rafael E. Droz-Seda, P.E. (HETI)



TESTING STANDARDS AND TESTING SEQUENCE:

Testing Standards:

1. Interior Florida Building Code (FBC) 2014, High Velocity Hurricane Zone (HVHZ).
2. Interior and Exterior Florida Building Code 2014, including Wind Borne Debris Region above 60 ft. of Elevation.
3. Interior and Exterior including Wind Borne Debris Region above 60 ft. of Elevation International Building Code (IBC) 2015, and as per ICC-ES Acceptance Criteria AC439.
4. Interior and Exterior National Building Code of Canada (NBC) 2015.

Testing Sequence (All tests performed on a single specimen):

1. Infill concentrated load test on 4"x4" and 12" x 12" squares.
2. Lateral and Downward Loads Test as per FBC/IBC Section 1618.4.6 and Section 1625 and ASTM E935-00 (Re-approved 2006) Sec. 4.3 (AC 439) and ASTM E2358-04 (Reapproved 2010) and Section 3.3 and 9.8 of NBC.
3. Horizontal and Vertical Loading per IBC/FBC section 2407.1.2 and ASTM E935-00 (Reapproved 2006) Sec. 4.3 (AC 439) and ASTM E2358-04 (Reapproved 2010) and AC439 Section 4.3 with a safety factor of four.
4. Uniform Static Air Pressure Test as per TAS 202 & ASTM E 330 as Section 1609 of FBC 2014 and IBC 2015 section 1609 with a safety factor of two.
5. ANSI Z97.1-1984 (R1994) Sec 5 for Class A 1618.4.6 & CPSC 16 CFR Part 1201 for Class II as per Section 1618.4.6 & 2407.1.4.1 of FBC 2010.
6. Safety Glazing Testing as per ASTM E2353-14 Section 13.3.6.2 (Type V)
7. Small Missile Impact Test as per ASTM 1886/1996 and FBC/IBC section 1609.1.2

CONSTRUCTION DETAILS

SPECIMEN SELECTION AND IDENTIFICATION

Number of Specimens	1
Method of Choosing	Provided by Manufacturer
Size of Specimen	143 7/8" wide x 43 1/2" high (non-fixed end) 144 1/8" wide x 44 3/8" high (fixed end)
Configuration	Fixed
Distance between Glass Lites	1/8"
Hand Rail	Hand rail was installed

COMPONENTS AND HARDWARE

Drawing No.	Description	Overall Dimension (in)	Maximum Thickness (in)	Material	Quantity
E1800130	Shoe Section	1.88 x 4.92	0.540	6060-T6	2
E1000424	Cap Rail	1.68 x 1.44	0.060	304/316 SS	1
E1110100	Wall Bracket	1.20 x 3.33	0.200	304/316 SS	1
E1807600	Glass Gasket	0.95 x 5.92 x 3.65	0.350	PVC Plastic	18
E807600	Glass Wedge	3.93 x 2.54	0.305	PVC Plastic	18
1999-200AGG2	Cap Gasket	0.97 x 0.95	0.090	EDPM	1
AR041886-0	Glazing Base Gasket	0.34x 0.67	0.136	EDPM	1

Glazing Material

Laminated Glass (NOA) 14-0916.11 by Kuraray America, Inc.:

- 1/4" Nominal (0.231" actual) Tempered Glass
- 0.090" Interlayer SentryGlas® by Kuraray America, Inc.
- 1/4" Nominal (0.231" actual) Tempered Glass
- 1/2" Nominal (0.552" actual) Total Thickness

Glass Size and Quantity

(3) 47 3/4" wide x 41 1/2" high

DLO:

(3) 47 3/4" wide x 37" high

Glazing Method

(18) Inlays were laid into the top mount extrusion at 8", 16", 23 3/4", 31 5/8", 39 1/2", 47 1/8", 55 3/8", 63 1/4", 72 1/4", 80", 87 3/4", 95 5/8", 103 1/2", 111 1/2", 119 3/8", 127 1/4", 135", and 141 5/8" from the left exterior end. (2) 0.26" thick x 0.48" wide x 3.34" long setting blocks with a Shore A Hardness of 82 were placed on top of each inlay before installing the glass lites. The glass was then installed, leveled, and set into place by installing (18) safety wedges, which were installed in the center of the inlay, on the opposite side of the glass. A 1/8" gap was left between each glass panel. The safety wedges were secured by hammering them down to a depth specified by the manufacturer using a manufacturer provided tool. Next the glazing gaskets, with a Shore A Hardness of 70, were installed on the interior and exterior of the glass. Lastly, the cap rail gasket, with a Shore A Hardness of 70, was installed on top of the glass followed by the cap rail.

Substrate Installation

4030 PSI Concrete

The floor/top mount extrusion was installed onto the concrete substrate in two separate pieces, both 71 7/8" in length, using (18) 3/8" x 4" Hilti KH-EZ Screw Anchors located at 4" from the exterior left end and then every 8" on center with a minimum edge distance of 4". **Note:** For loads noted using a fixed end, a wall bracket was installed using (3) #12 x 1" anchors.

INSTRUMENTATION

1. Digital Deflection Gauge System: HETI - 0311 and HETI - 1060
2. Manual Hydraulic Pump and Cylinder
3. Force Measurement System: HETI - 0182 and HETI - 0850
4. Test Wall System B, Pressure Transducer HET I- 0357
5. Test Wall System B, Deflection Gage HETI - 0172

TEST RESULTS


Loading Procedure:

1. Apply 50% of the maximum load.
2. Apply Maximum load in increments of 15%.
 - a. Each increment held for 120 seconds.
 - b. Record the deflection at start and end of 120 seconds period.
 - c. Rate of loading shall be 5.0 mm per minutes to the desired load if possible.

4" Infill Test (Lateral Load)

Test Date: July 6, 2016


Description of Location	Duration (sec)	Force Applied (lbs)
Center of Edge of Middle Lite	300	112.4
Center of Edge of Middle Lite	300	284

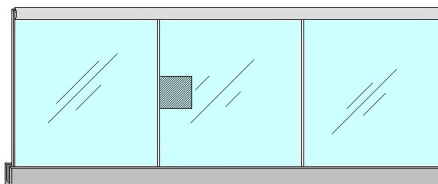

12" Infill Test (Lateral Load)

Test Date: July 6, 2016

Description of Location	Duration (sec)	Force Applied (lbs)
Edge of Hand Rail	300	50
Edge of Hand Rail	300	200

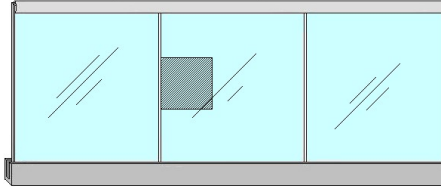

Horizontal and Vertical Loading per ASTM E935-00 (Reapproved 2006) Sec. 4.3 (AC 439) and ASTM E2358-04 (Reapproved 2010).


Loading Procedure:

1. Apply 50% of the maximum load.
2. Apply Maximum load in increments of 15%.
 - a. Each increment held for 120 seconds.
 - b. Record the deflection at start and end of 120 seconds period.
 - c. Rate of loading shall be 5.0 mm per minutes to the desired load if possible.

Test Date: July 6 – 7, 2016

Horizontal Load Application												
	Force (lbs)	Time (Sec)	Loc. #1		Set (in)	Loc. #2		Set (in)	Loc. #3A			
			Deflection (in)			Start	End		Deflection (in)		Start	End
			Start	End					Start	End		
From Interior Side	200	300	0.000	1.462	0.092				0.513	0.533	0.016	
	400	300	0.000	2.549	0.089				1.304	1.416	0.076	
	520	120	0.000	3.188		2.047	2.062		1.609	1.682		
	640	120	3.889	3.948		2.417	2.436		2.013	2.072		
	760	120	4.677	4.706		2.799	2.841		2.371	2.444		
	800	120	5.116	5.133	0.088	2.971	3.012	0.065	2.514	2.591		
	1200	120	0.00	0.775	0.153				3.483	3.584	0.176	
Ext Side	257	120							0.000	1.125	0.038	
	514	120							0.000	4.004	0.701	
Vertical Load Application												
Top Rail	50	300	0.000	0.021	0.002				0.000	0.042	0.011	
	100	300	0.000	0.041	0.003				0.000	0.030	0.010	
	130	120	0.000	0.045					0.000	0.026		
	160	120	0.051	0.054					0.038	0.043		
	190	120	0.060	0.062					0.052	0.058		
	200	120	0.063	0.064	0.022				0.060	0.062	0.018	
	275	120	0.171	0.186	0.036				0.161	0.170	0.022	

Horizontal and Vertical Loading Points: (location 1 up to 400 lbf without end clip and with clip thereafter.)

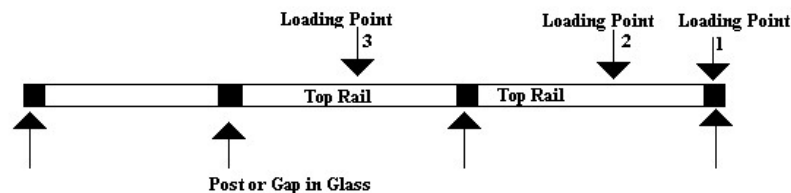


Rail	3A	2	1
	3B		
Glass	Glass		Glass

**Horizontal and Vertical Loading per ASTM E935-00 (Reapproved 2006) Sec. 4.3 (AC 439)
and ASTM E2358-04 (Reapproved 2010) Level 2/ Type L-2**


Test Date: July 7, 2016

Description of Location	Duration (sec)	Force Applied (lbs)	Deflection (in.)	Set (in.)	Recovery (%)
Horiz. Center of Hand Rail	60	334	---	---	---
Vert. Center of Hand Rail	60	334	---	---	---
Center Glass was removed prior to applying load. Railing and Glass were intact and no damaged was observed.					

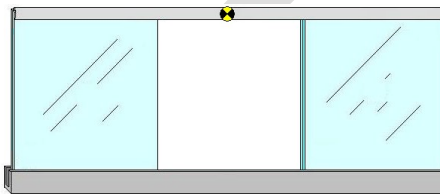

Test Date: July 7, 2016

Description of Location	Duration (sec)	Force Applied (lbs)	Deflection (in.)	Set (in.)	Recovery (%)
Horiz. Center of Hand Rail	60	334	---	---	---
Vert. Center of Hand Rail	60	334	---	---	---
Right Corner Glass was removed prior to applying load and the corner was fixed using the wall bracket. Railing and Glass were intact and no damaged was observed.					

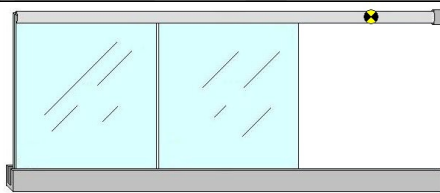


Uniform Static Air Pressure Test as per TAS 202 & ASTM E 330

Uniform Static Air Pressure Test Results

Test Date: July 8, 2016

	Pressure (psf)	Def. Loc #1 (In)	Set Loc # 1 (In)	Recovery Loc # 1 (%)	Duration (sec)
Positive Pressure					
Half Test Load	+ 40	2.68	0.13	95	30
Design Load	+ 80	5.04	0.20	96	30
Test Load	+130	6.99	0.22	97	30
Negative Pressure					
Half Test Load	- 40	1.65	0.00	100	30
Design Load	- 80	3.45	0.27	92	30
Test Load	-130	5.25	0.36	93	30

Uniform Load Test was performed with ASTM E330-14 test method. See Figure for Loc # 1.

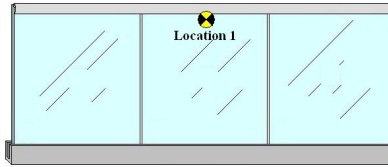

(Interior View)

Safety Glazing Testing as per ANSI Z97.1-1984 (R1994)


TEST PROCEDURE

The test specimen as described in construction details was tested .The sample was impacted at center of each glass with a 100-pound lead Impactor. The Impactor was constructed as specified in ANSI Z97.1-1984 (R1994). The drop height and test results are summarized in table below.

TEST RESULTS

Test Date: July 8, 2016

No.	Drop Height (in)	Results
Center of Left Glass Lite		
1	12	Glass was intact and no damaged was observed.
2	18	Glass was intact and no damaged was observed.
3	48	Glass was intact and no damaged was observed.
Center of Middle Glass Lite		
1	12	Glass was intact and no damaged was observed.
2	18	Glass was intact and no damaged was observed.
3	48	Glass was intact and no damaged was observed.
Center of Right Glass Lite		
1	12	Glass was intact and no damaged was observed.
2	18	Glass was intact and no damaged was observed.
3	48	Glass was intact and no damaged was observed.

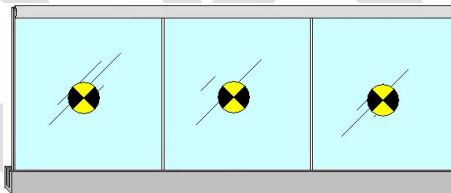

☼ - Impact Locations (interior view)

Safety Glazing Testing as per ASTM E2353-14 Section 13.3.6.2 (Type V)


TEST PROCEDURE

The test specimen as described in construction details was tested .The sample was impacted at center of each glass with a 100-pound lead Impactor. The Impactor was constructed as specified in ASTM E2353-14 Section 13.3.6.2 (Type V). The drop height and test results are summarized in table below.

TEST RESULTS

Test Date: July 8, 2016

No.	Drop Height (in)	Results
Center of the Middle Glass Lite		
1	60	Glass was intact and no damaged was observed.
8" (max) Below the Top of the Hand Rail		
1	60	Glass was intact and no damaged was observed.

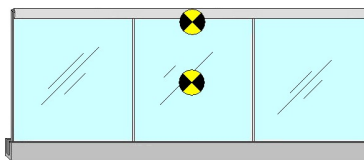


☼ - Impact Locations (interior view)

Small Missile Impact Test

<i>Impact Location</i>	<i>Speed (fps)</i>	<i>Observations (in)</i>	<i>Description of Result</i>
Center of Left Glass Lite	130	----	No Penetration or Failure
Corner of Left Glass Lite	130	----	No Penetration or Failure
Edge of Left Glass Lite	130	----	No Penetration or Failure
Center of Middle Glass Lite	130	----	No Penetration or Failure
Corner of Middle Glass Lite	130	----	No Penetration or Failure
Edge of Middle Glass Lite	130	----	No Penetration or Failure
Center of Right Glass Lite	130	----	No Penetration or Failure
Corner of Right Glass Lite	130	----	No Penetration or Failure
Edge of Right Glass Lite	130	----	No Penetration or Failure

The impact consisted of (10) 2 gram steel balls.

**The interior glass stayed intact on all lites, and the handrail remained in place after the impacts.*

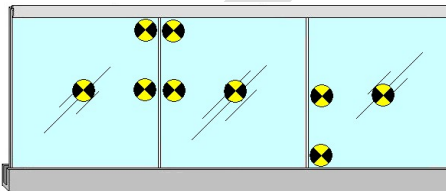

● - Impact Locations (exterior view)

Conclusion

The test sample represented intended construction as indicated in the marked drawing. The sample was tested in accordance with provisions of Florida Building Code 2014, International Building Code 2015.

The Railing was intact and all parts were securely in place at the conclusion of each test.

NOTE: The above results were obtained using the designated test methods that indicates compliance with the performance requirements of the referenced specifications. This report does not constitute certification of the specimens tested.

STATEMENT OF INDEPENDENCE

The Hurricane Engineering & Testing, Inc., does not have, nor does it intend to acquire or will acquire, a financial interest in any company manufacturing or distributing products tested or labeled by the Hurricane Engineering & Testing, Inc. Hurricane Engineering & Testing, Inc., is not owned, operated or controlled by any company manufacturing or distributing products it test or labels.

Dr. Nasreen K. Ali
Vice President

Mr. Rafael E. Droz-Seda, P.E.
Resident Engineer